Location\Filename: V:\eng\ACAD_STD\Technical Details\A - Water Details\A-07d - Typical Fire Hydrant Connection for High Pressure .dwg
Plotted on: Monday, September 24, 2012 - 10:19 AM by Lallemand, Jacques

Boston Water and Sewer Commission
980 HARRISON AVE., BOSTON, MA 02119
(617) 989-7000
www.bwsc.org

TYPICAL FIRE HYDRANT CONNECTION FOR HIGH PRESSURE

Scale: Not To Scale

DATE: June 30, 2012

DETAIL NO. A-07d
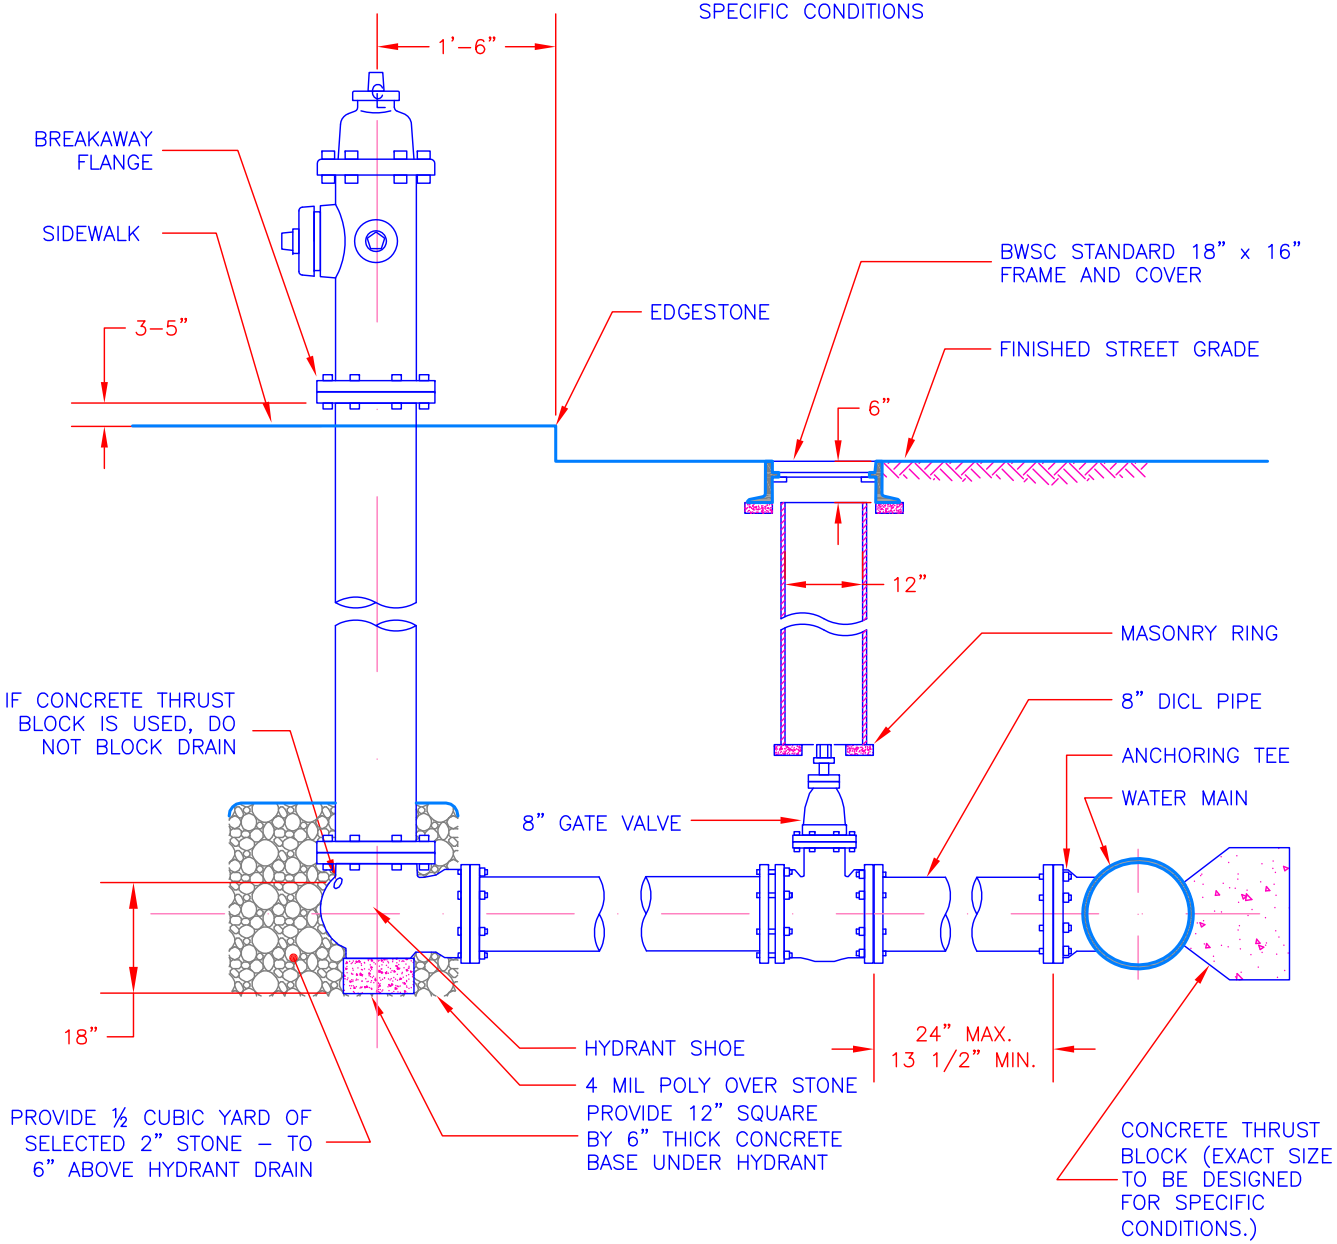
NOTES:
1. CONCRETE TRUST BLOCK TO BE USED ONLY WHERE IT WILL BEAR ON UNDISTURBED EARTH
2. USE RESTRAINED JOINT FITTINGS (MEGALUG OR APPROVED EQUAL) WHERE CONCRETE THRUST BLOCK IS UNACCEPTABLE
3. SIZE OF BLOCK OR MEGALUG TO BE DESIGNED FOR SPECIFIC CONDITIONS