


NOTES:

1. ALL WORK MUST BE PERFORMED BY A BWSC LICENSED AND BONDED CONTRACTOR.
2. THIS PROCEDURE WILL INVOLVE A MAIN LINE SHUT DOWN THAT THE CONTRACTOR WILL COORDINATE WITH THE BWSC'S OPERATIONS DIVISION.
3. WRITTEN NOTIFICATION OF ALL AFFECTED CUSTOMERS MUST BE PERFORMED BY THE CONTRACTOR.
4. ALL WORK MUST BE PERMITTED BY BWSC AND ALL OTHER APPROPRIATE AGENCIES.
5. ALL WORK MUST BE INSPECTED BY BWSC INSPECTOR OR DESIGNEE.

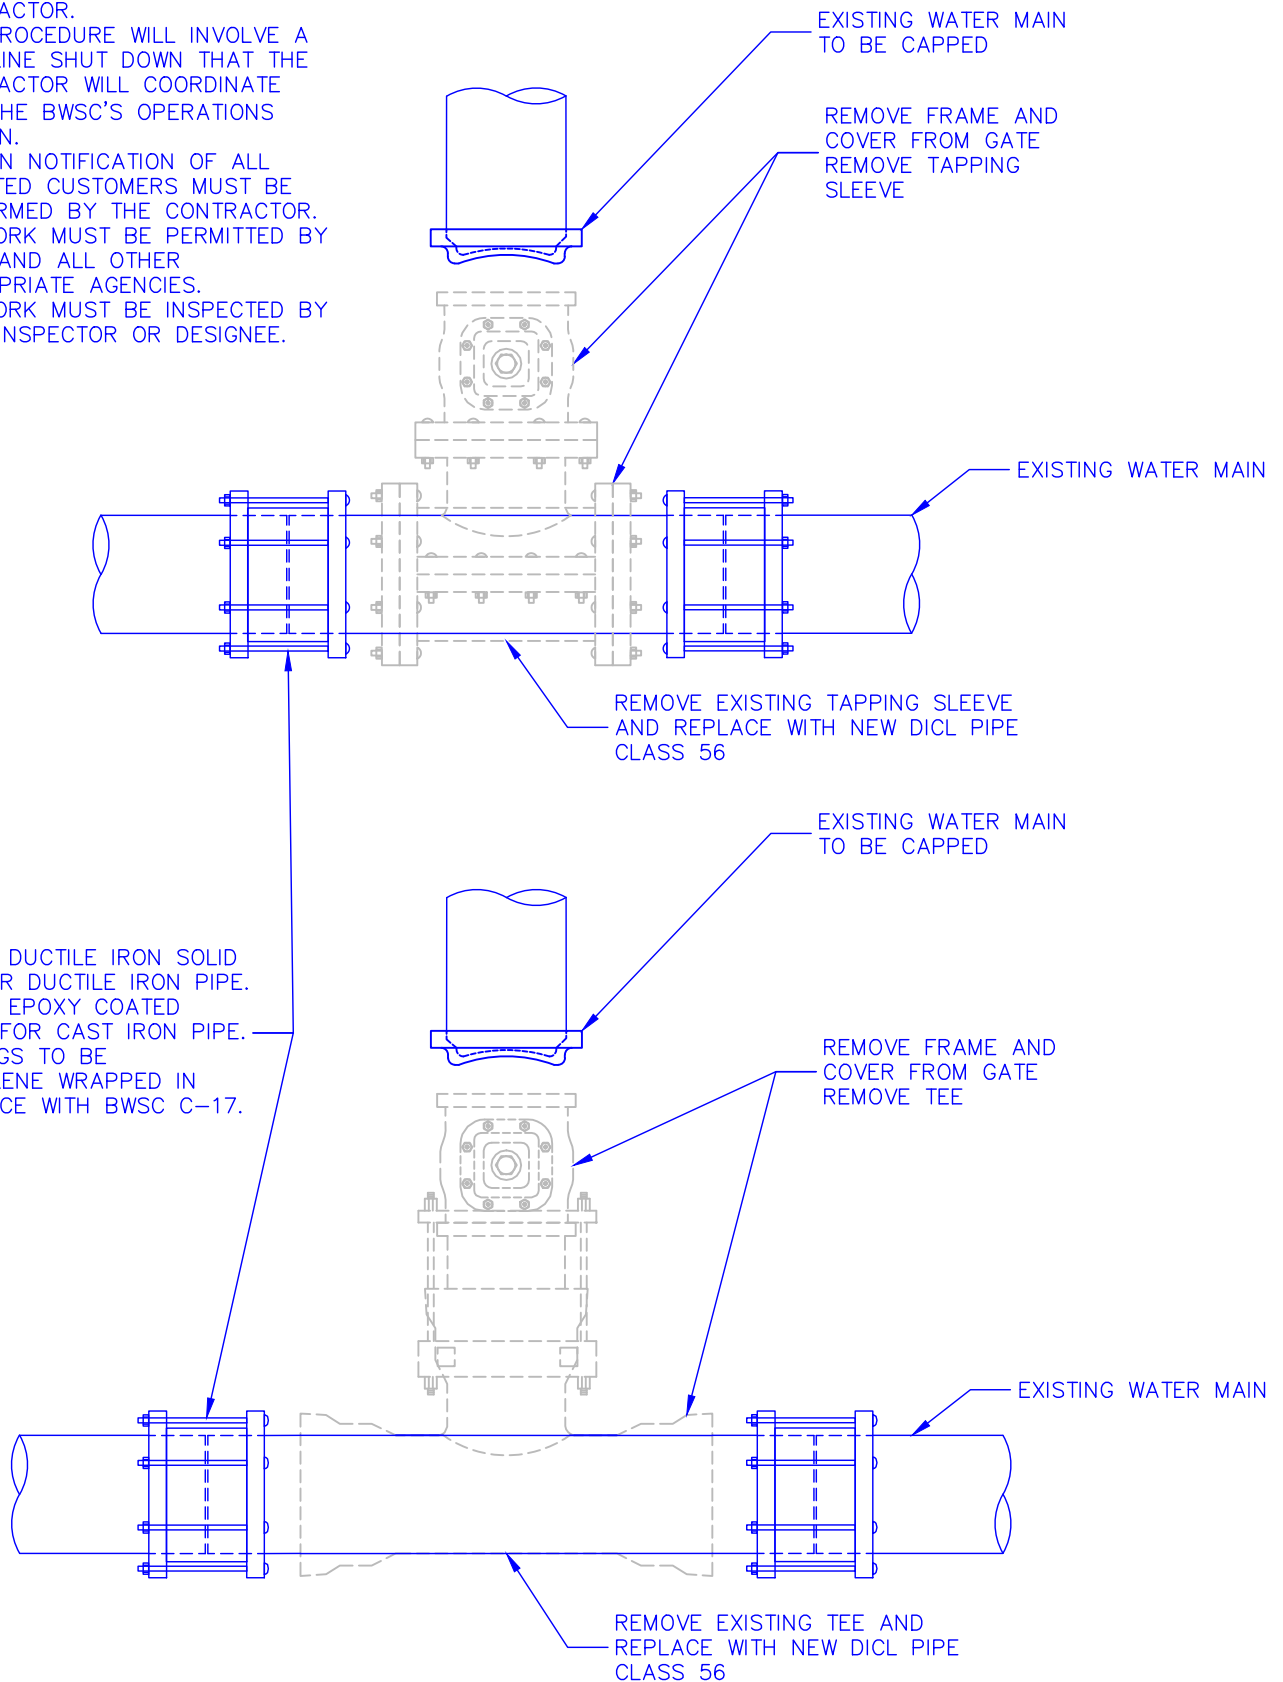

APPROVED DUCTILE IRON SOLID SLEEVE FOR DUCTILE IRON PIPE.
 APPROVED EPOXY COATED COUPLING FOR CAST IRON PIPE.
 ALL FITTINGS TO BE POLYETHYLENE WRAPPED IN ACCORDANCE WITH BWSC C-17.

Location\Filename: V:\eng\ACAD_STD\Technical Details\A - Water Details\A-15 Detail of Abandonment of Water Connection 3-Inch and Greater.dwg
 Plotted on: Wednesday, August 13, 2014 - 3:45 PM by Donohoe, William



Boston Water and Sewer Commission
 980 HARRISON AVE., BOSTON, MA 02119
 (617) 989-7000 www.bwsc.org

DETAIL OF ABANDONMENT OF WATER CONNECTION 3-INCH AND GREATER

Scale: Not To Scale


DATE:
 August 13, 2014

DETAIL NO.
A-15a

NOTES:

1. ALL WORK MUST BE PERFORMED BY A BWSC LICENSED AND BONDED CONTRACTOR.
2. THIS PROCEDURE WILL INVOLVE A MAIN LINE SHUT DOWN THAT THE CONTRACTOR WILL COORDINATE WITH THE BWSC'S OPERATIONS DIVISION.
3. WRITTEN NOTIFICATION OF ALL AFFECTED CUSTOMERS MUST BE PERFORMED BY THE CONTRACTOR.
4. ALL WORK MUST BE PERMITTED BY BWSC AND ALL OTHER APPROPRIATE AGENCIES.
5. ALL WORK MUST BE INSPECTED BY BWSC INSPECTOR OR DESIGNEE.

- * IN CASE OF ANCHOR TEE, REMOVE VALVE AND INSTALL CAP.
- ** IN CASE OF TAPPING SLEEVE ON DUCTILE IRON, REMOVE SLEEVE AS ON CAST, INSTALL NEW PIPE WITH SOLID SLEEVES.

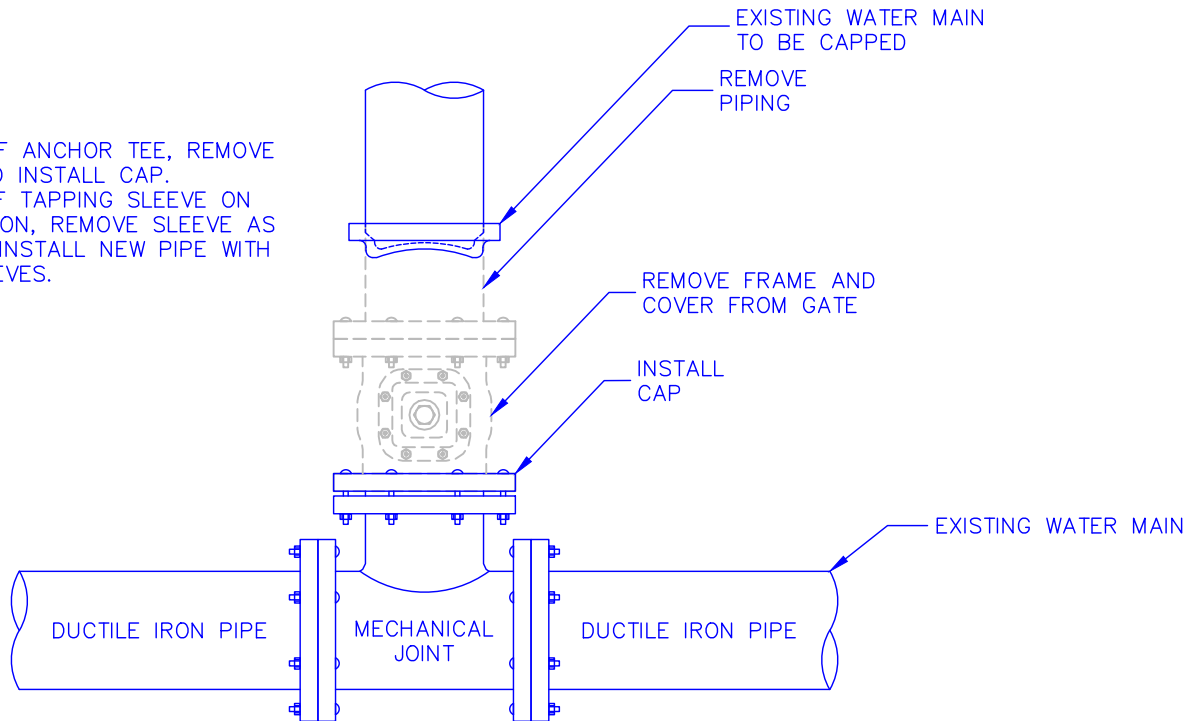

**Boston Water and
Sewer Commission**

980 HARRISON AVE., BOSTON, MA 02119
(617) 989-7000 www.bwsc.org

**DETAIL OF ABANDONMENT OF WATER
CONNECTION 3-INCH AND GREATER**

Scale: Not To Scale

DATE:
August 13, 2014

DETAIL NO.
A-15b